CORRIDOR WALLS	REQUIRED:	1/2 HOUR CORRIDOR WALL PER TABLE 1016.1 WITH 20-MINUTE PROTECTED OPENINGS PER TABLE 715.3.
	PROVIDE:	1-HR UL WALL ASSEMBLY #U419 WITH 20 MIN. PROTECTED OPENINGS. RE: A0.1.16
EXIT WALLS OCCUPANCY SEPARATION	REQUIRED:	2 HOUR EXIT ENCLOSURE PER SECTION 1019.1 WITH 90-MINUTE PROTECTED OPENINGS PER TABLE 715.3. 2 HOUR SEPARATION BETWEEN OCCUPANCIES PER TABLE 302.3.2 W/90 MIN PROTECTED OPN'GS, TABLE 715.3
	PROVIDE:	2-HR UL WALL ASSEMBLY #U419 WITH 90 MIN. PROTECTED OPENINGS. RE: A0.1.16
SHAFT WALLS	REQUIRED:	2 HOUR SHAFT ENCLOSURE PER SECTION 707.4 WITH 90-MINUTE PROTECTED OPENINGS PER TABLE 715.3
	PROVIDE:	2-HR UL WALL ASSEMBLY #U498 OR MIN. 2-HR CONCRETE SHAFT PER TABLE 721.2.1.1
STRUCTURAL FRAME	REQUIRED:	3 HOUR STRUCTURAL FRAME PER TABLE 601
	PROVIDE:	4-HR FIRE WALL. REFER TO SECTIONS.
UNIT SEPARATION WALL ELEVATOR LOBBIES	REQUIRED:	1 HOUR DWELLING UNIT SEPARATION WALL
	PROVIDED:	1-HR UL WALL ASSEMBLY #U419 WITH 20 MIN. PROTECTED OPENINGS. RE: A0.1.16
SEPARATION AT TRANSFORMER & VAULT	REQUIRED:	4 HOURS PER POWER COMPANY REQUIREMENTS
	PROVIDED:	4-HR UL WALL ASSEMBLY #U901 WITH 3-HR MIN. PROTECTED OPENINGS. RE: A0.1.14
DEMISING WALLS	REQUIRED:	1 HOUR DIMESNO WALL PER 708.3 FIRE PARTITIONS
	PROVIDE:	1-HR UL WALL ASSEMBLY #U419.

3 LEGEND

1. EXTERIOR BEARING WALLS SHOWN ARE 3-HOUR MINIMUM RATED WALLS WITH UNPROTECTED OPENINGS PER TABLE 601.
2. INTERIOR BEARING WALLS SHOWN ARE 3-HOUR MINIMUM RATED WALLS. WITH UNPROTECTED OPENINGS PER TABLE 601.
3. ALL EXTERIOR AND INTERIOR WALLS ARE OF NONCOMBUSTIBLE CONSTRUCTION.
4. REFER TO BUILDING PLANS AND UNIT PLANS FOR PARTITION TYPES.
5. TYPE 1A/SPRINKLERED CONSTRUCTION PER TABLES 503 & 601.
6. REFER TO ELECTRICAL FOR LOCATIONS OF ILLUMINATED EXIT SIGNS.
7. REFER TO ELECTRICAL FOR LOCATIONS OF FIRE ALARM PULL STATIONS AND FIRE ALARM DEVICES.
8. REFER TO ELECTRICAL FOR LOCATIONS OF HEAT AND SMOKE DETECTORS.

2 GENERAL NOTES

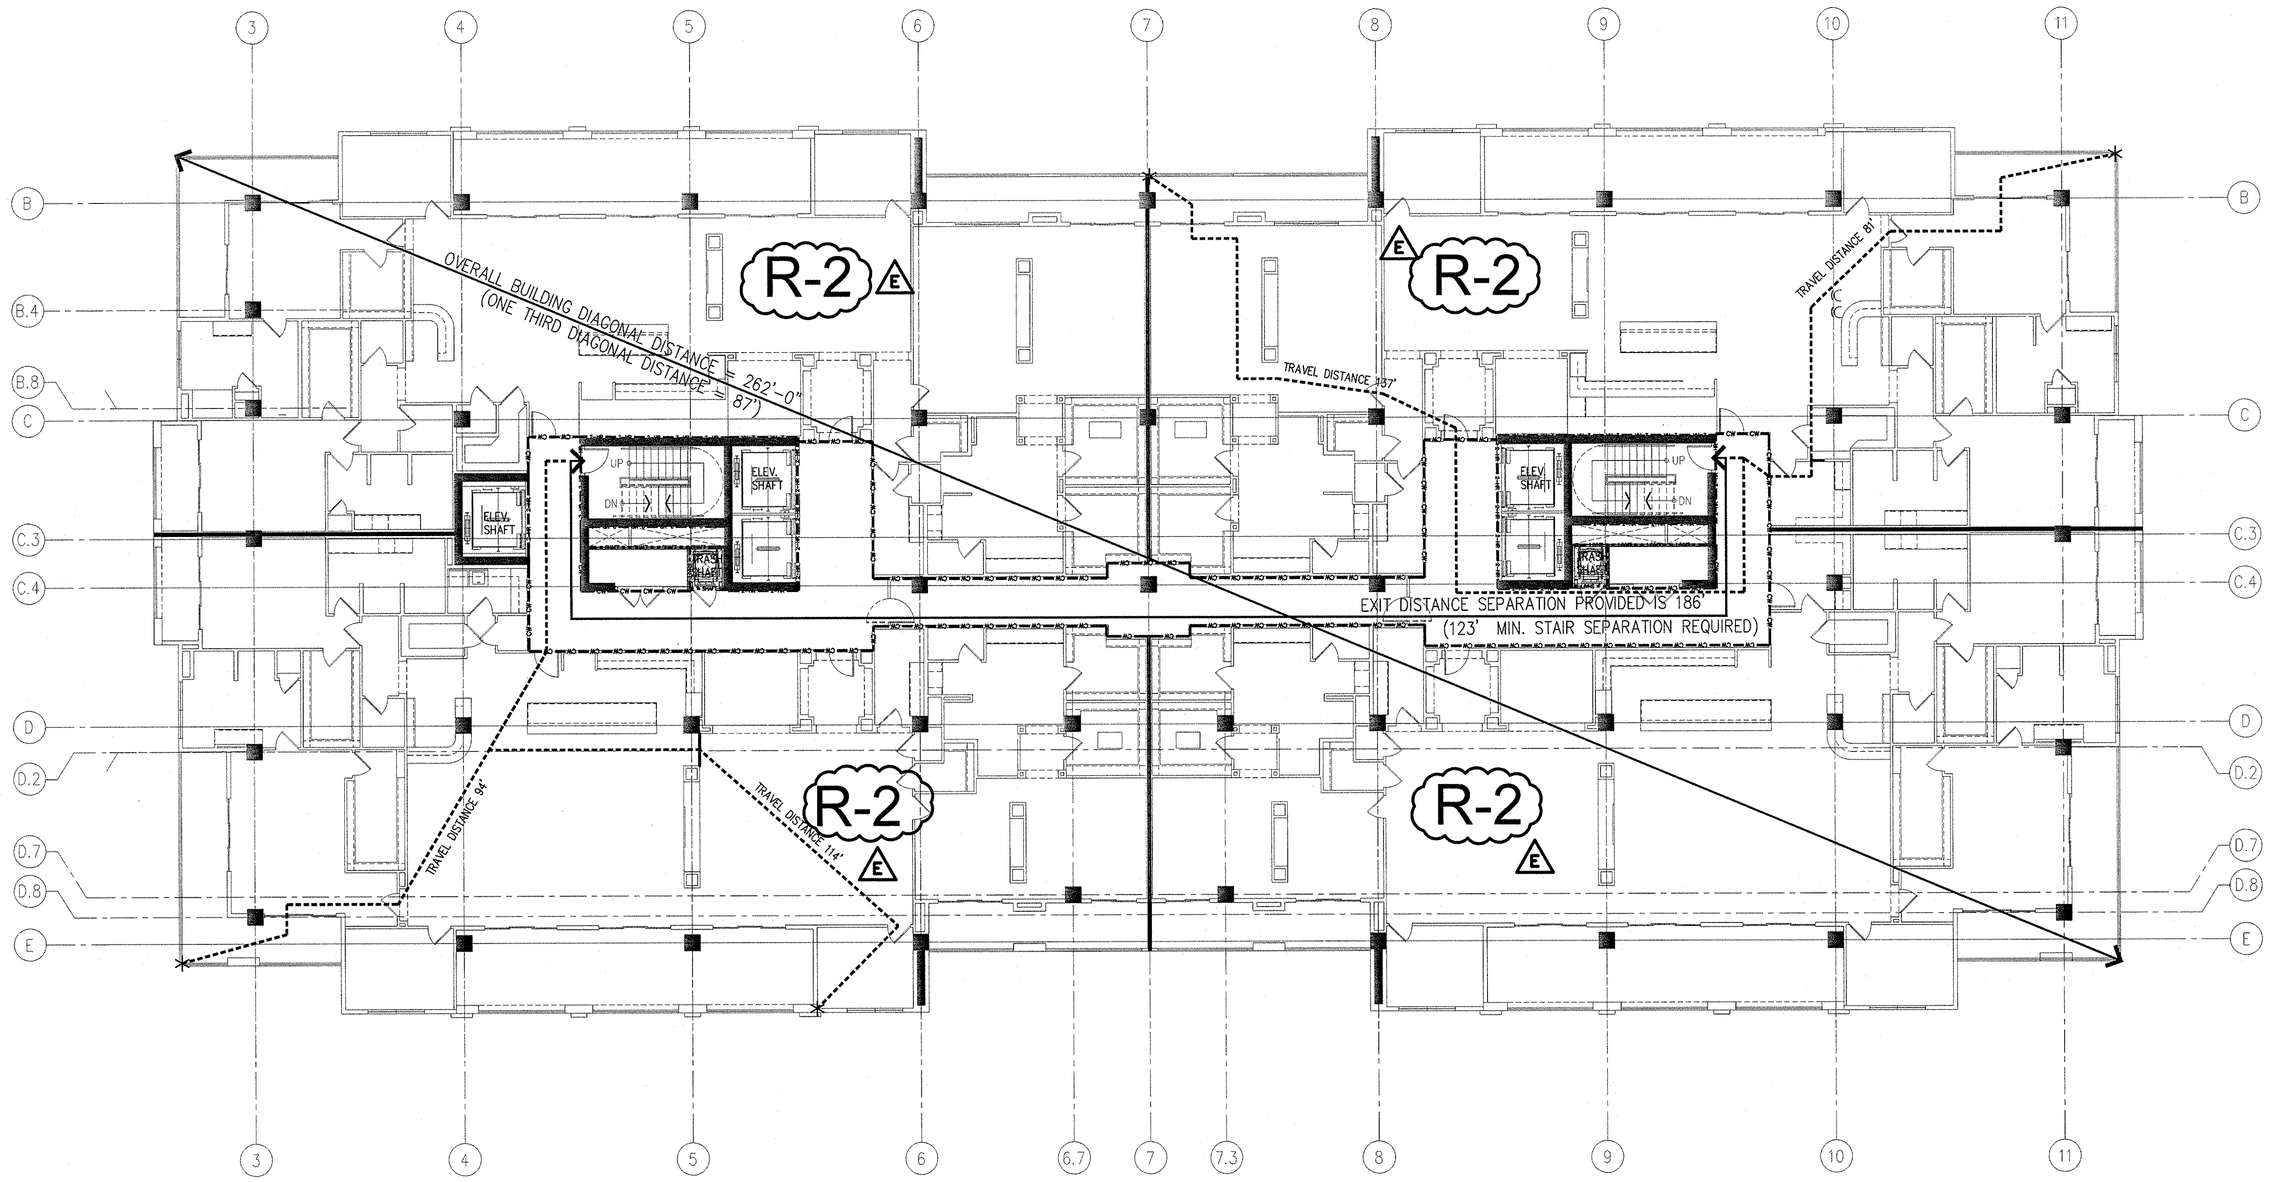

EDI architecture
EDI ARCHITECTURE INC.
2800 Post Oak Boulevard
SUITE 3800
HOUSTON, TEXAS 77056
(713) 375-1400
FAX (713) 375-1600
www.EDIArchitecture.com
TEXAS CALIFORNIA NEW YORK

CODE DRAWING – PLAN – LEVELS 22 & 23

3/32"=1'-0"

PROJECT "X"

HOUSTON, TEXAS

ARCHITECT: BRITTEN L. PERKINS
LICENSE NO. 12130
FIRM CORP. ID # (440226-00)

DRAWN BY: C.R.G.

CHECKED: _____ DATE

REVISIONS:
E 07/30/2009

PROJECT NO: 07018.000
ISSUED: FOUNDATION PERMIT
ISSUED DATE: 07-18-07
FILE:

COPYRIGHT © 2009
EDI ARCHITECTURE, INC.
ALL RIGHTS RESERVED

DRAWING NUMBER

G013

CODE PLAN

N W E S

FOR REFERENCE ONLY